




**SINGLE HV CIRCUIT WITH FIBRE OPTIC AND
EARTH ROPE - CABLE IN DUCTS**

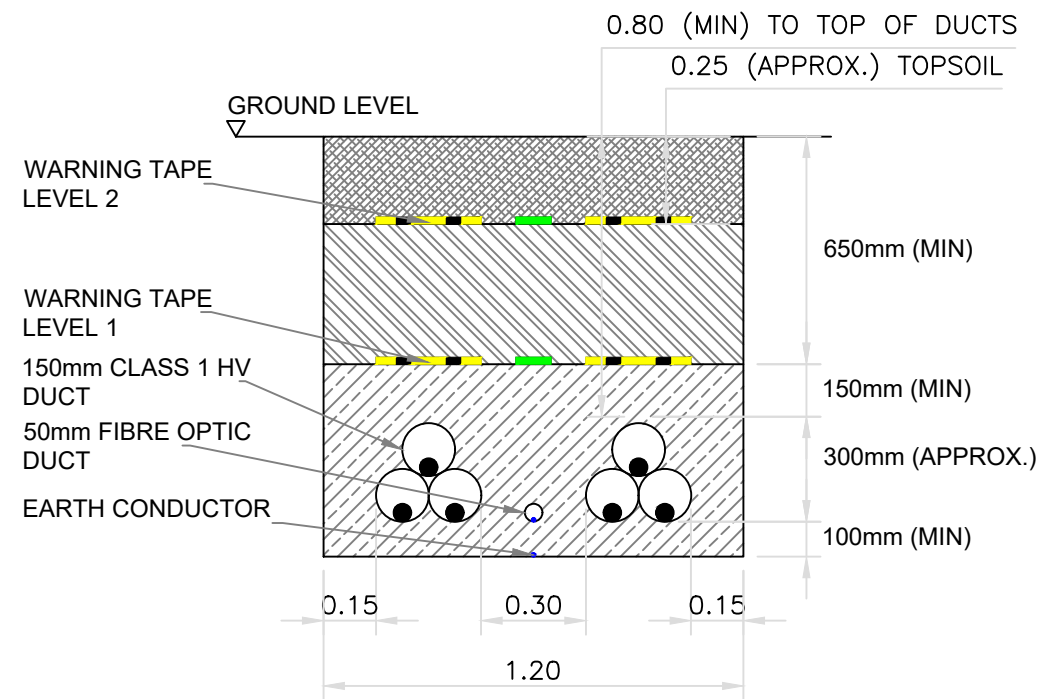

**DOUBLE HV CIRCUIT WITH FIBRE OPTIC
AND EARTH ROPE - CABLE IN DUCTS**

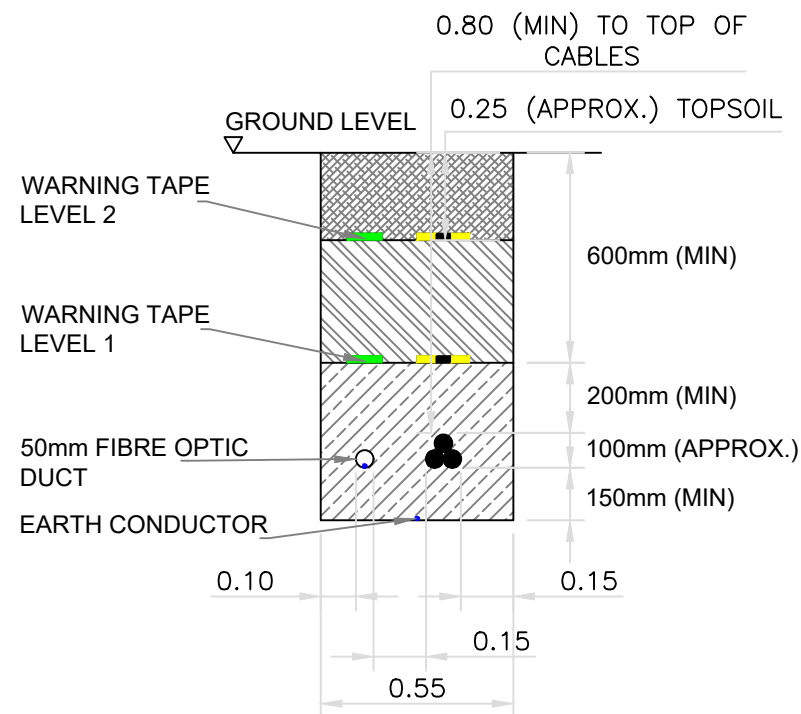


**SINGLE HV CIRCUIT WITH FIBRE OPTIC AND
EARTH ROPE - CABLES LAID DIRECT**

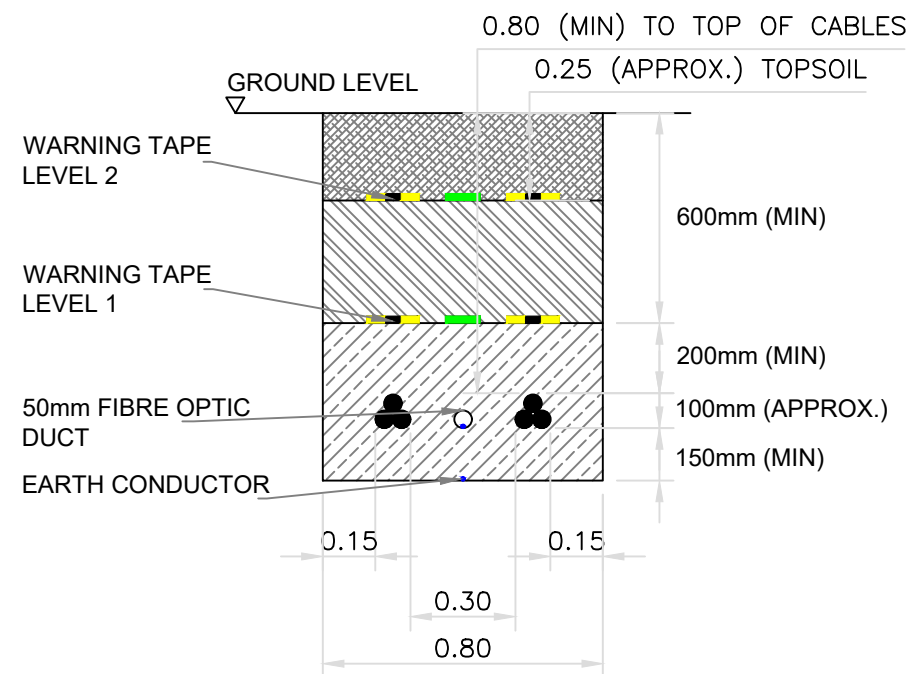

**DOUBLE HV CIRCUIT WITH FIBRE OPTIC AND
EARTH ROPE - CABLES LAID DIRECT**

LEGEND

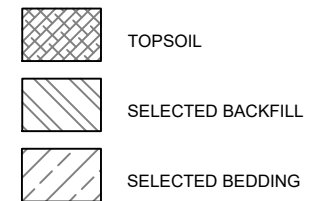

1	02/05/19	For Issue	NGB	JJD	JJD
Rev.	Date	Amendment Details	Drawn	Chk'd	App'd



Sweco, Grove House, Mansion Gate Drive, Leeds, LS7 4DN
Tel: +44 (0)113 262 0000



Client:
**PENCLOE WIND ENERGY
LIMITED**

Project:
**PENCLOE WIND FARM
VARIATION**

Drawing Title:
**TYPICAL CABLE TRENCH DETAILS
FIGURE 4.11**

Scale @ A3	1:20	DO NOT SCALE
Project No.	121714	

This drawing should not be relied on or used in circumstances other than those for which it was originally prepared and for which Sweco UK Limited was commissioned. Sweco UK Limited accepts no responsibility for this drawing to any party other than the person by whom it was commissioned. Any party which breaches the provisions of this disclaimer shall indemnify Sweco UK Limited for all loss or damage arising therefrom.